

Business Item 2018-21:
Ratification of Emergency
Declaration for Repair of St.
Croix Valley Odor Control and
Sludge Loadout Building

Rene Heflin, Manager, Plant Engineering Technical Services


Environment Committee: January 9, 2018



St. Croix Valley WWTP, Oak Park Heights




Odor
Control/Sludge
Loadout Building



Preliminary Estimates of Fire Damage

- One odor control fan
- One carbon odor control unit
- One odor control panel
- 36” and 48” diameter FRP duct
- Wire and conduit for process and building HVAC
- Fire detection system
- Lighting
- Soot and fire debris throughout the building



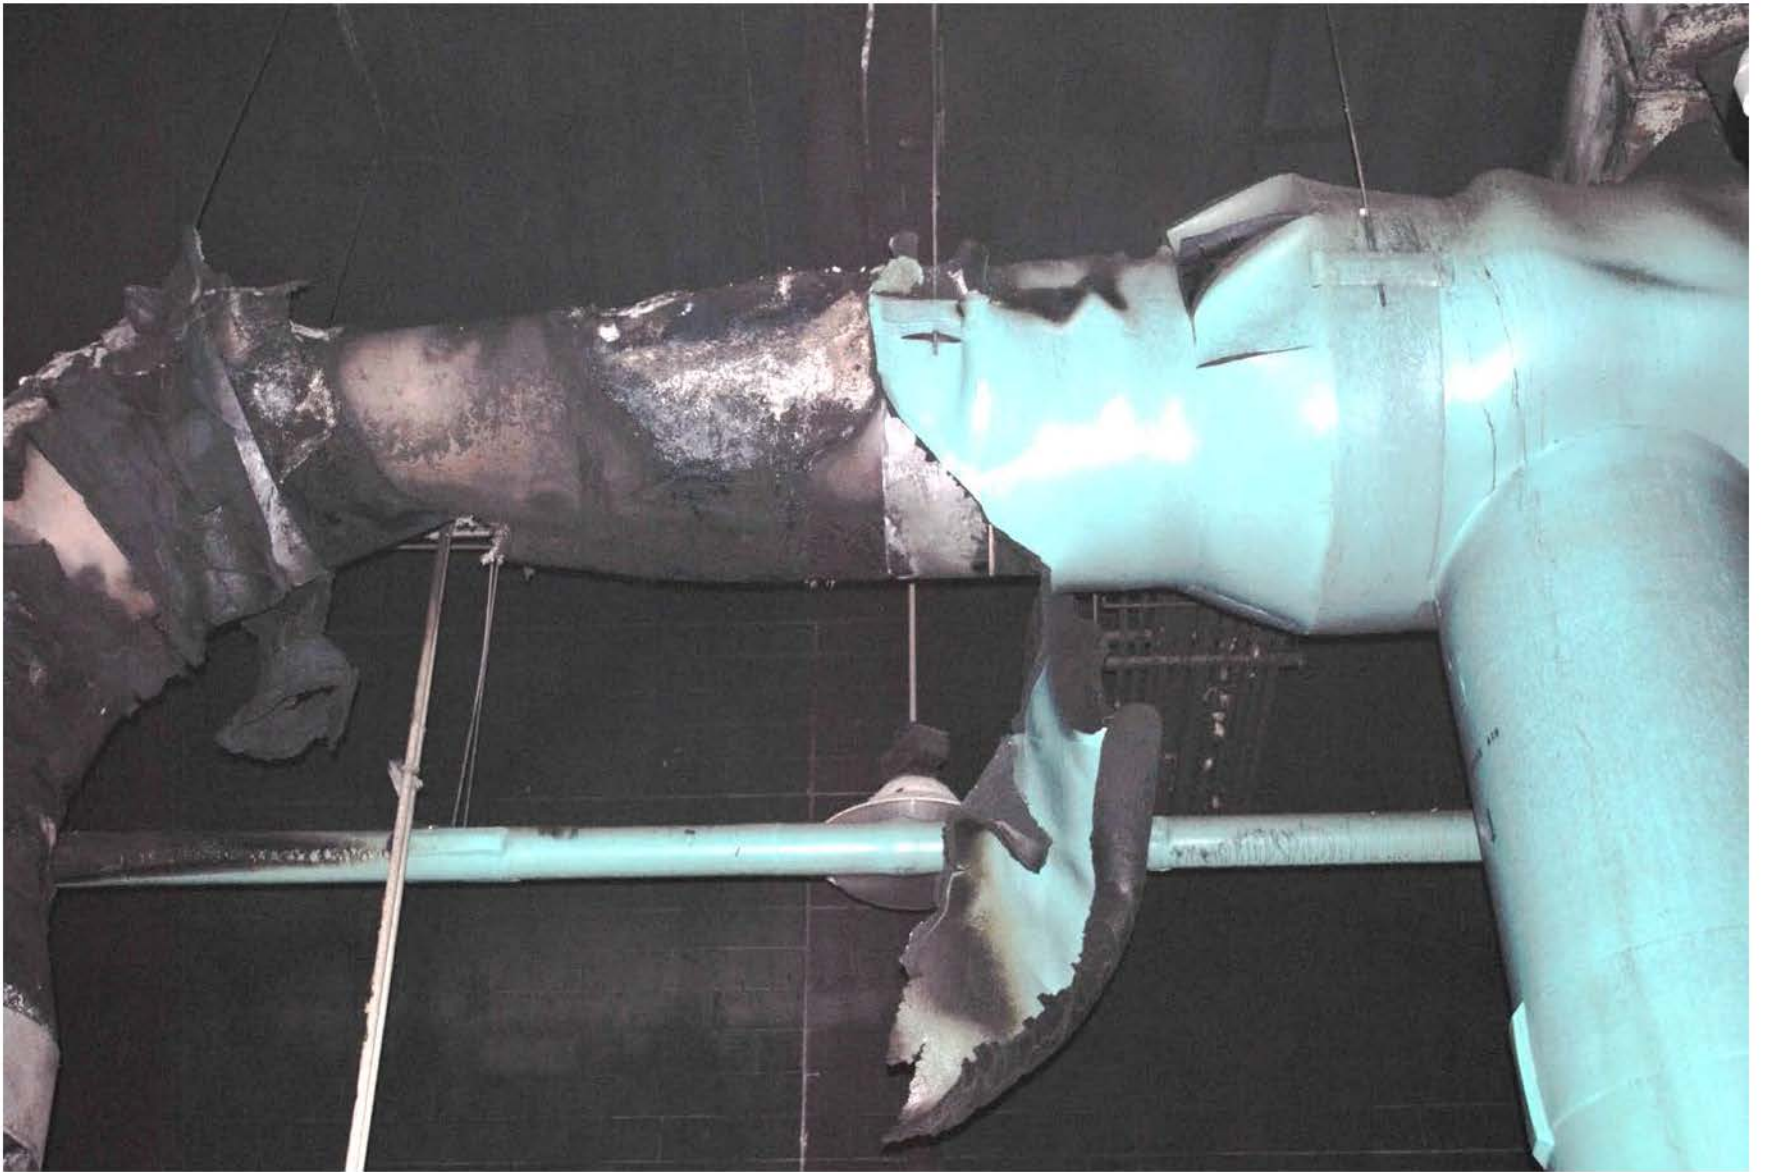

Thrive Lens Analysis

- Stewardship – works supports efforts to maintain the region's wastewater treatment system

Proposed Action

- That the Metropolitan Council ratifies the Emergency Declaration attached to the business item for repair of the Odor Control and Sludge Loadout building at the St. Croix Valley Wastewater Treatment Plant in the estimated amount of \$750,000.

Questions