




1. Chemical Odor Control system located outside and above grade at MCES lift station

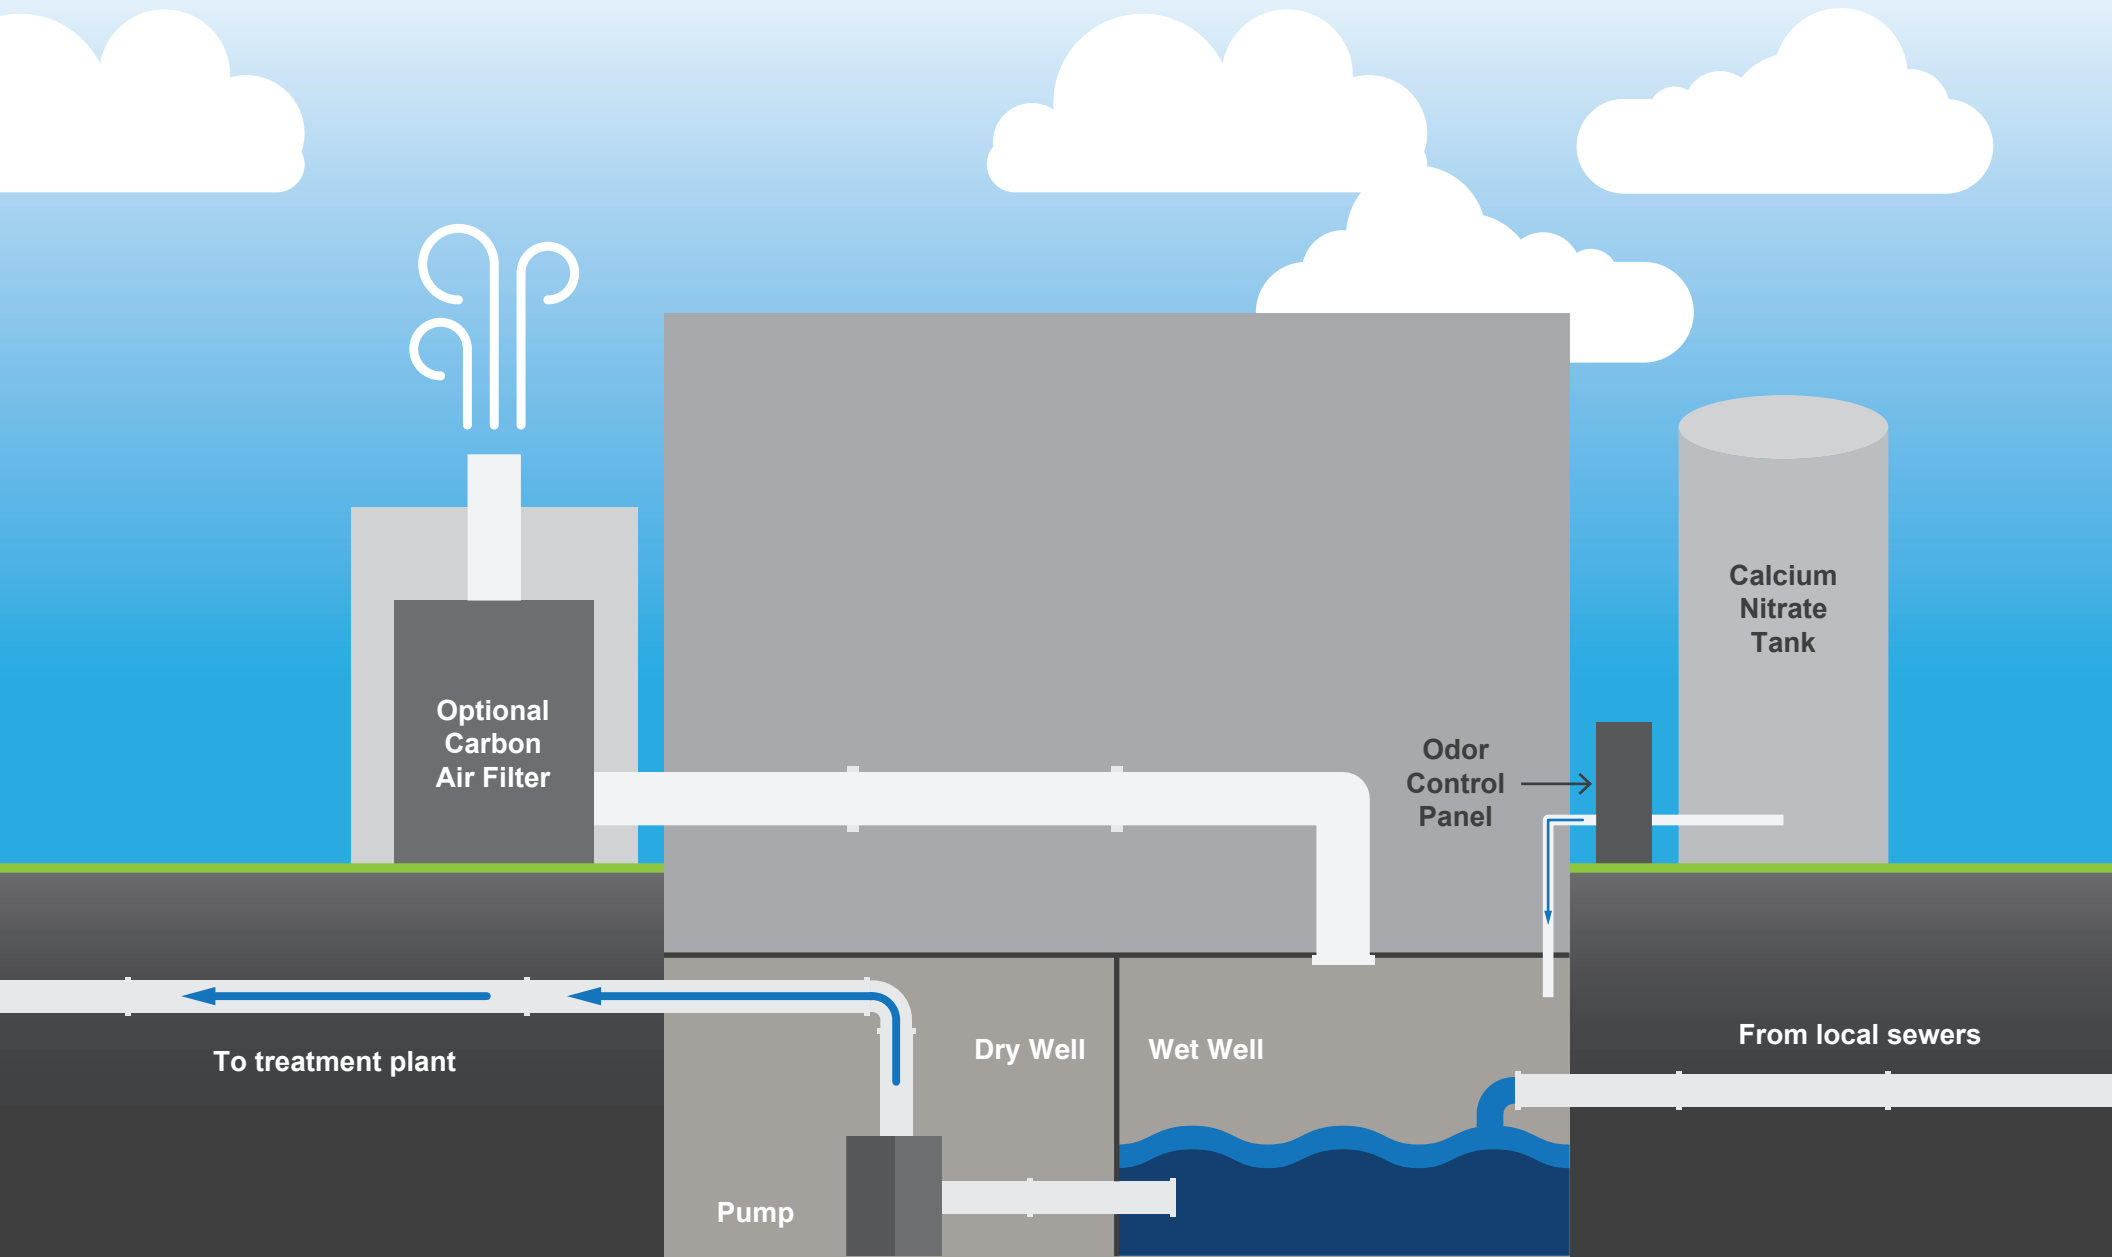

2. Chemical Odor Control system located within MCES lift station (if room is available)

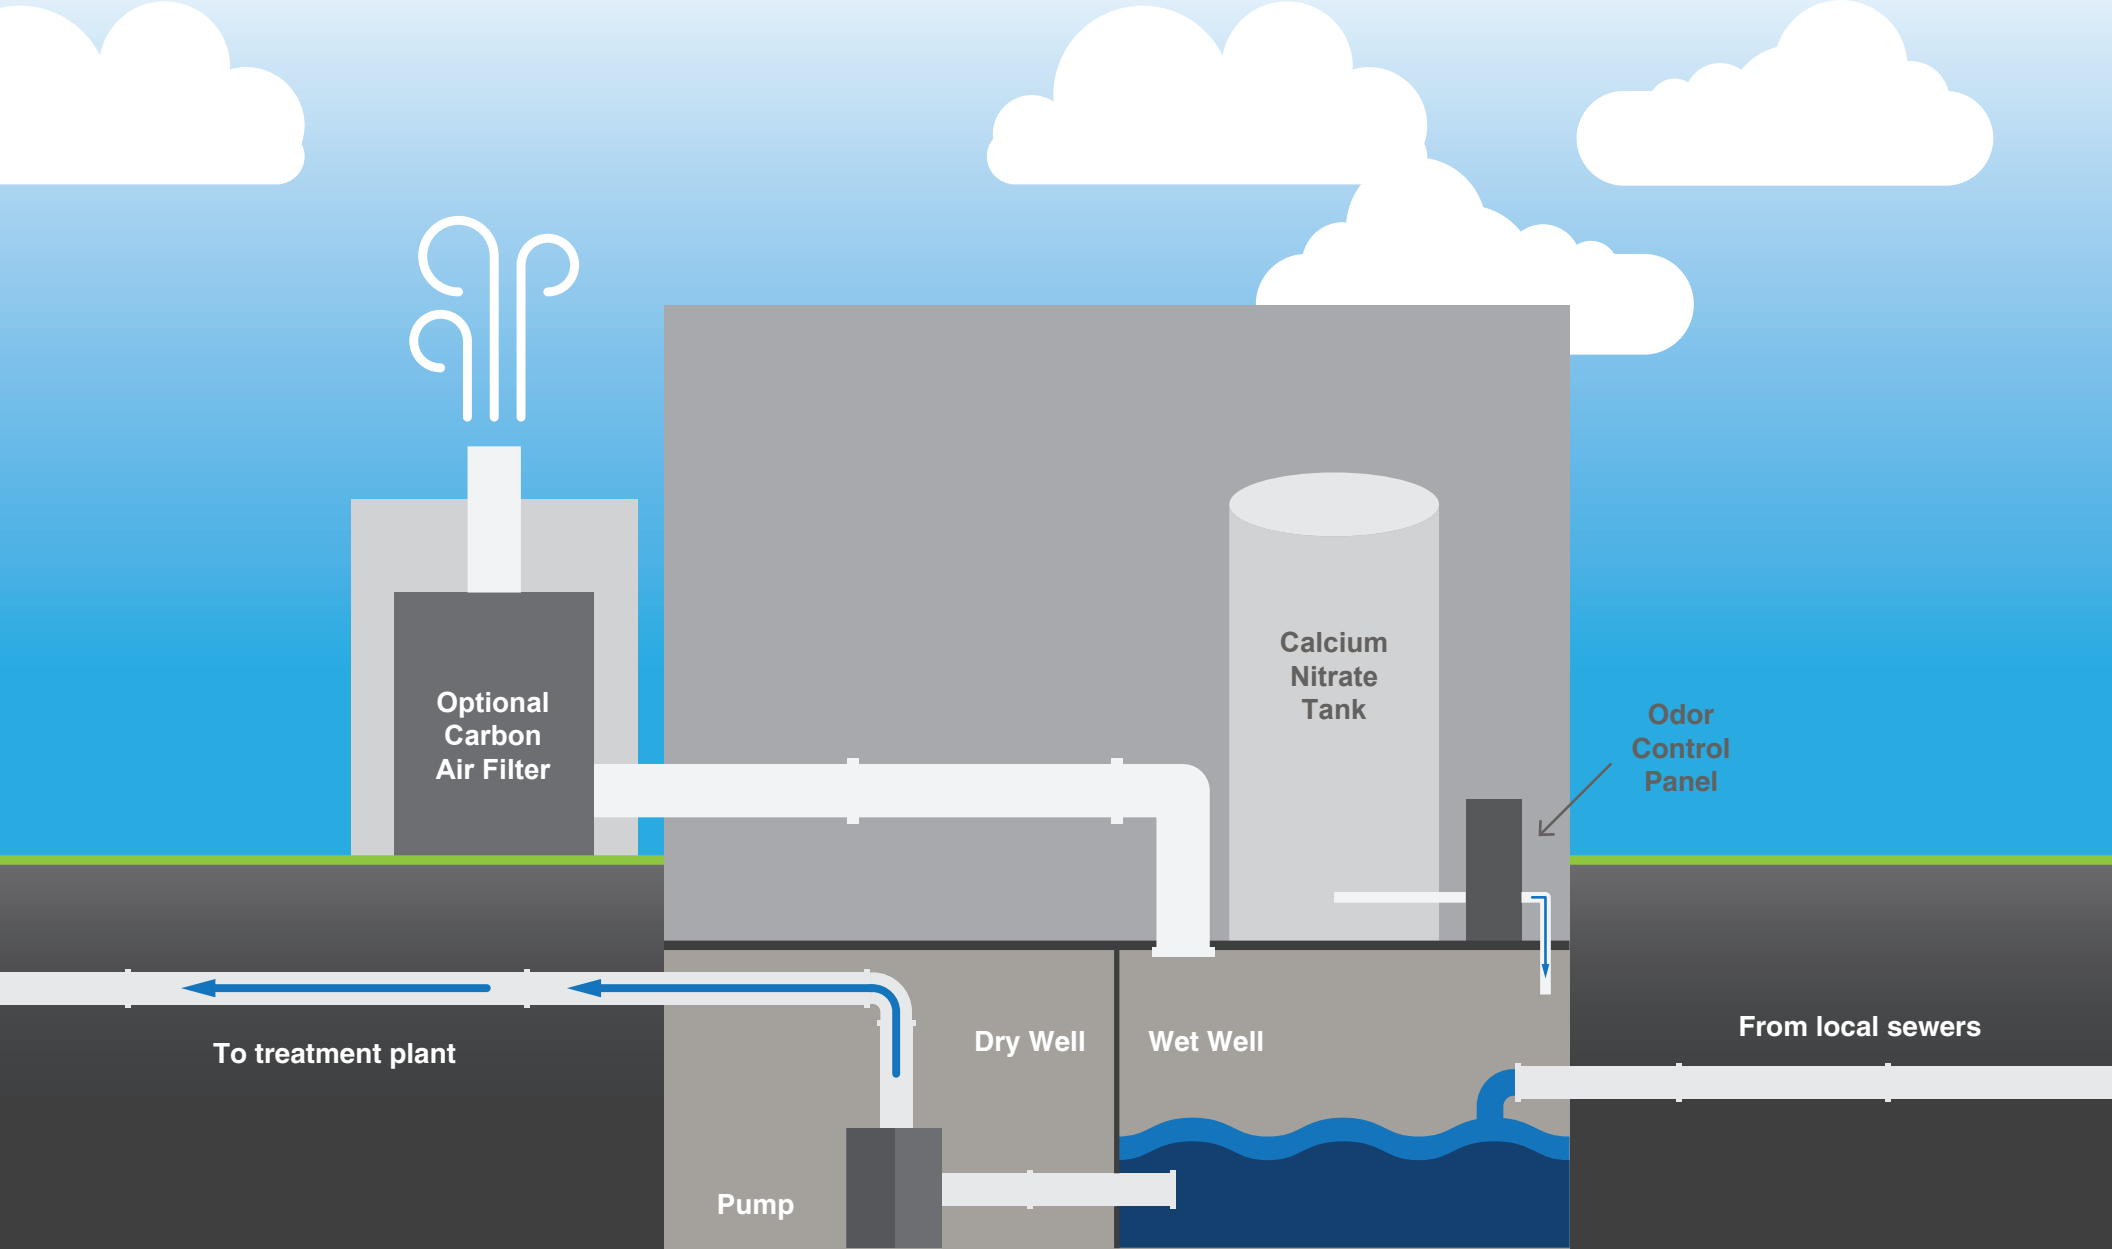

3. Chemical Odor Control system located outside and above grade at MCES meter station

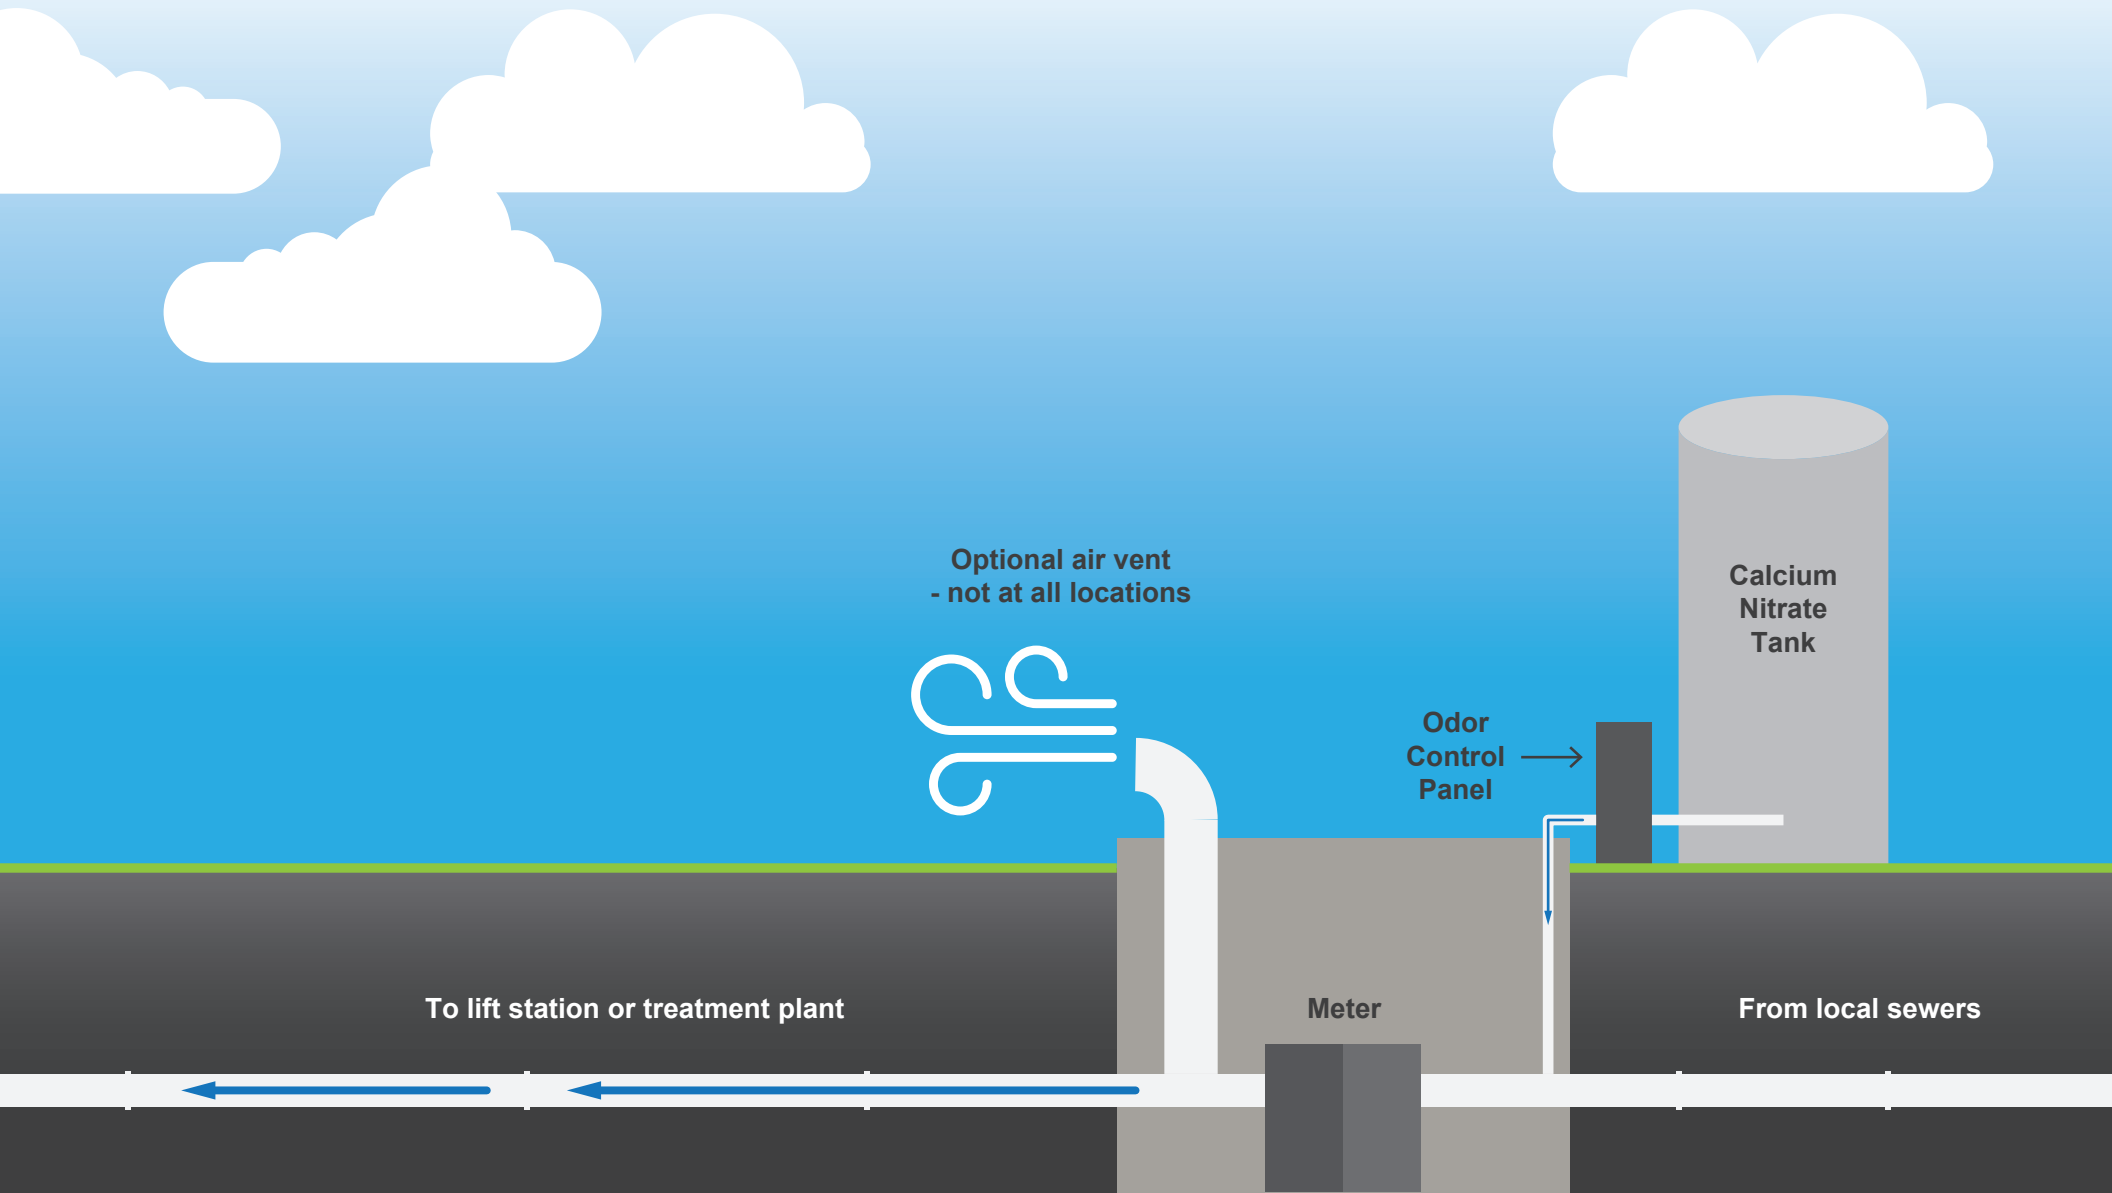

4. Chemical Odor Control system located below grade at MCES meter station (location dependent)

